


	301/TS11	301/TQ24
	230V~ 50Hz	230V~ 50-60Hz
	—	R100h / +25°C
<b>P</b>	0,6 W	
	± 2 s/d +25 °C	
	16A/250V~μ cos φ = 1	
	1 ... 4 mm <sup>2</sup>	0,5 ... 2,5 mm <sup>2</sup> 8 mm
	-10°C ... +55°C	
	-10°C ... +60°C	


## Safety notes

This product should preferably be installed by a qualified electrician. Non-compliance may result in a fire hazard or electric shocks. Before installation, read the operating instructions and observe the product-specific requirements for the installation location. Use only original spare parts for repair and maintenance. All products may be opened and repaired only by specially trained personnel. Unauthorised opening and repair by other persons will invalidate all claims for liability, replacement or warranty services.

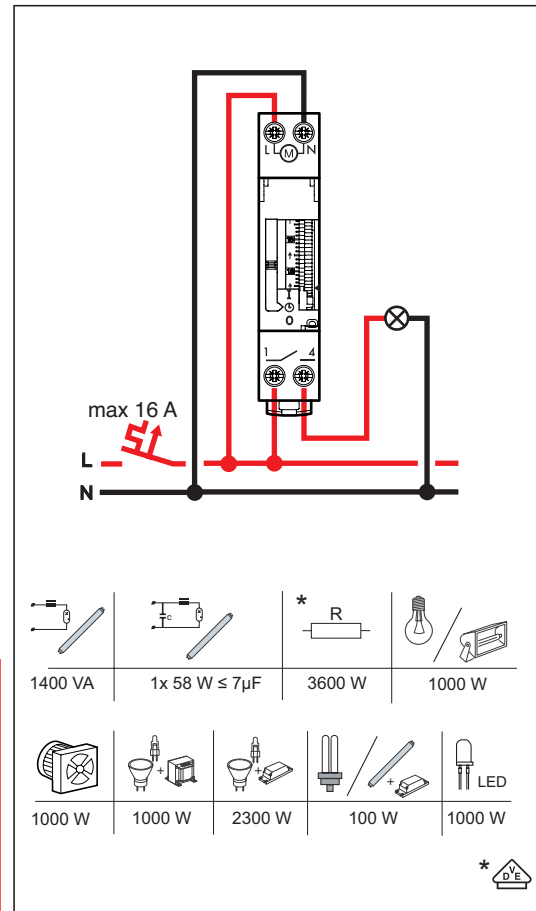


### Setting the time


Turn the dial in direction of the arrow and set the time against the  $\blacktriangle$ . E.G. 10.00 clock.

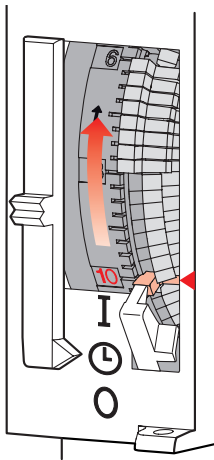

### Setting the switching times

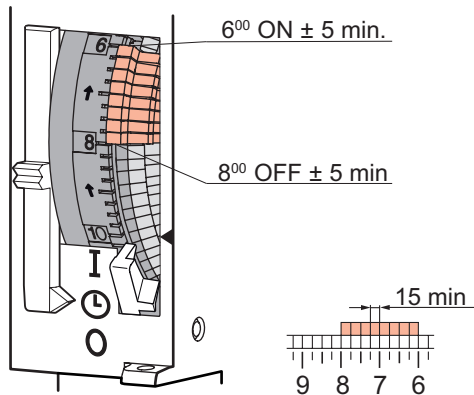

### Hand switch

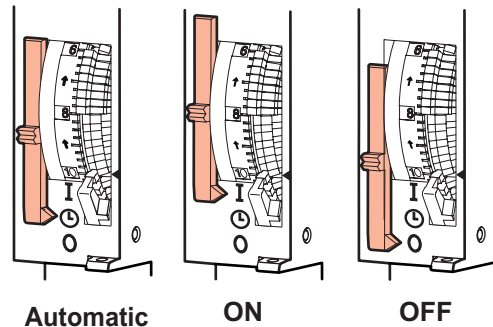

Operating principle: Typ 1.B. S/R. T.  
IEC/EN 60730-1, IEC/EN 60730-2-7  
Operation in a normal environment  
Montage: in distribution panel  
Degree of contamination: 2  
Switch output, potential-free

Disposal: Switch off the device before removing the battery.

