



DANGER: LIVE PARTS ENCLOSED. Ensure the unit is installed by a qualified competent person in accordance with all relevant legislation and regulations including building regulations and wiring regulations BS7671. If in doubt, contact a qualified competent person.



IMPORTANT INFORMATION

Follow the instructions below before working on or inside the equipment.



- Turn off all power supplies
- Always use a calibrated volt-sensing device to confirm the power is off.
- Replace all devices, doors and covers before turning on the power to this equipment.
- To avoid ingress of swarf and similar material, always remove gland plates to allow cutting/slotting for cable entries.
- Do not use power screwdrivers on electrical connections.



Failure to follow these instructions could result in serious injury or death.

Fitting & Wiring Instruction

Remove the incomer front plate and the gland plates from the bottom of the Distribution Boards and from the Horizontal Lighting & Power Metering Board.

Fit the unit below the Distribution and place the Short Joining Rails from inside the Distribution Board's enclosures and Long Joining Rail from inside of Horizontal Lighting & Power Metering Board.

Connect two enclosures using 8 off M5x16mm bolts, washers and nuts as shown in Fig. 1.

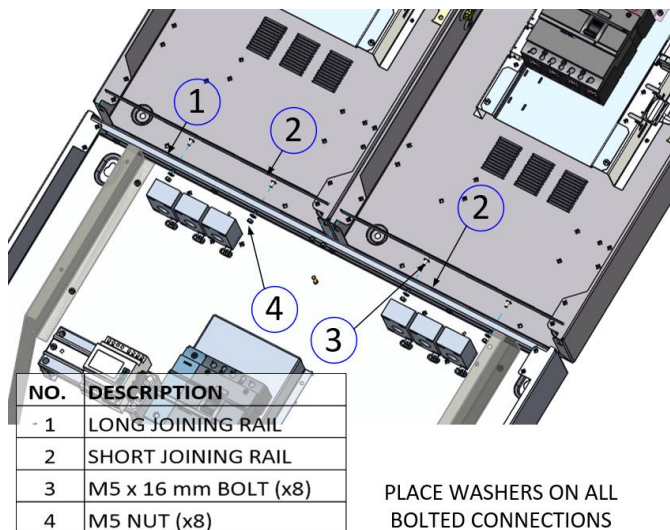


Fig. 1

Wiring Instruction

Connect the neutral cable (marked blue) to the Distribution Board neutral terminal clamp or incomer neutral terminal as shown in the Fig 2. If necessary, cut cables to length.

Fit heat shrink sleeve to cables for phase identification, then cut and strip insulation back 20 mm and re-crimp with ferrules provided.

Connect the phase cables (marked brown, black and grey) to the Distribution Board incomer following the cable colours/marking (see Fig 2).

Fully tighten terminal cages and cable clamps to torque as recommended in the Distribution Board instruction leaflet.

Meter setup Instruction

7KT1661 – Standard meter. The current transformer ratio has been factory set to 250/5 A

7KT1662 – MID meter. The current transformer ratio has been factory set to 250/5 A and it cannot be changed.

NOTE!

Parts of the installation in which the meter kit is to be installed may remain live even when isolated. When working on unit FULLY open all meter fuses.

Refer to meter manual to set up the meters. Follow the link below. (See page 42 to 66 and in the Manual).

Manual 7KT PAC1600 energy meter - Online Support



<https://support.industry.siemens.com/cs/document/109759827/manual-7kt-pac1600-energy-meter?dti=0&lc=en-GB>

Re-fitting Instruction

- Check the tightness of **all** connections, including factory made connections.
- Affix supplied fuse warning labels in a clearly visible area in the following places:
 1. beneath or next to meter fuses
 2. beneath or next to isolator on front shield.
- Fit the bottom gland plate and
- Refit all front plates



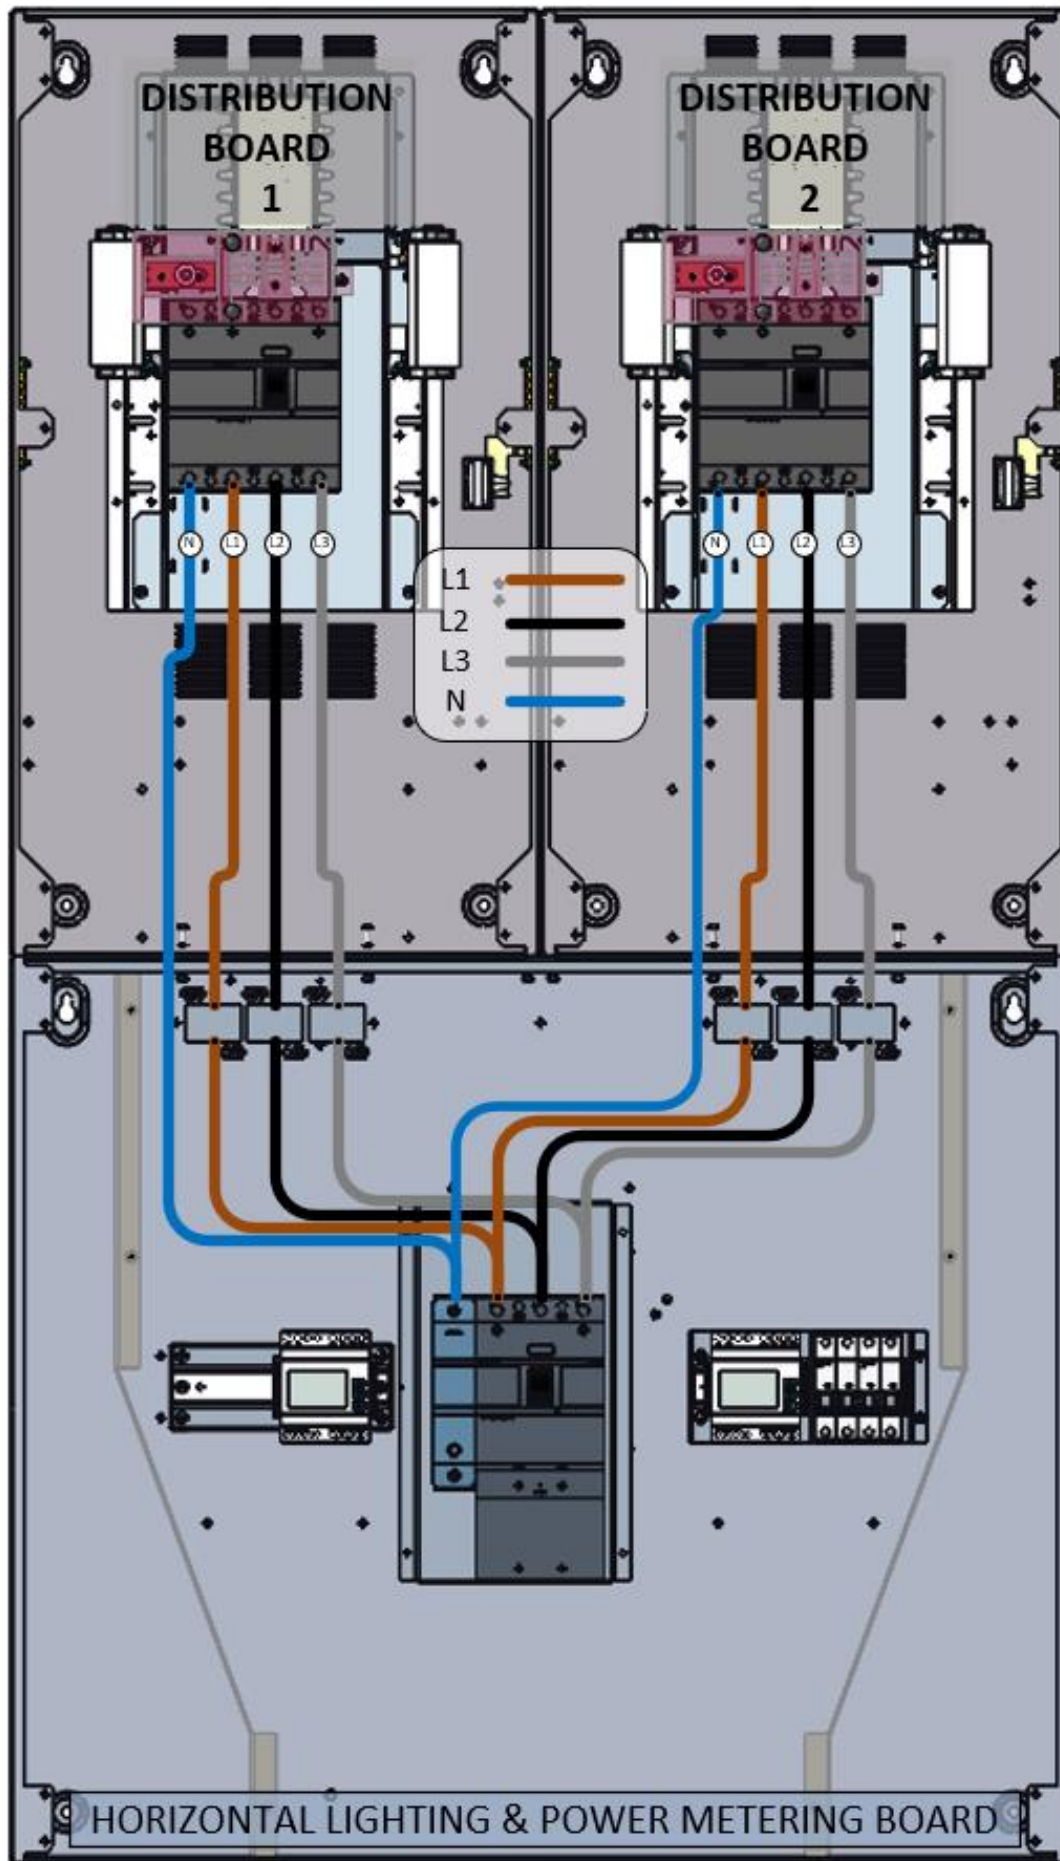


Fig. 2



SIEMENS

Sharston Road, Manchester M22 4RA, England
 Tel: 01543 455000 Fax: 01543 455001

LF1598_2



Waste electrical products should not be disposed of with household waste.
 Please recycle where waste disposal facilities exist.
 Check with your retailer, wholesaler or local authority for recycling advice.